




VICINITY MAP

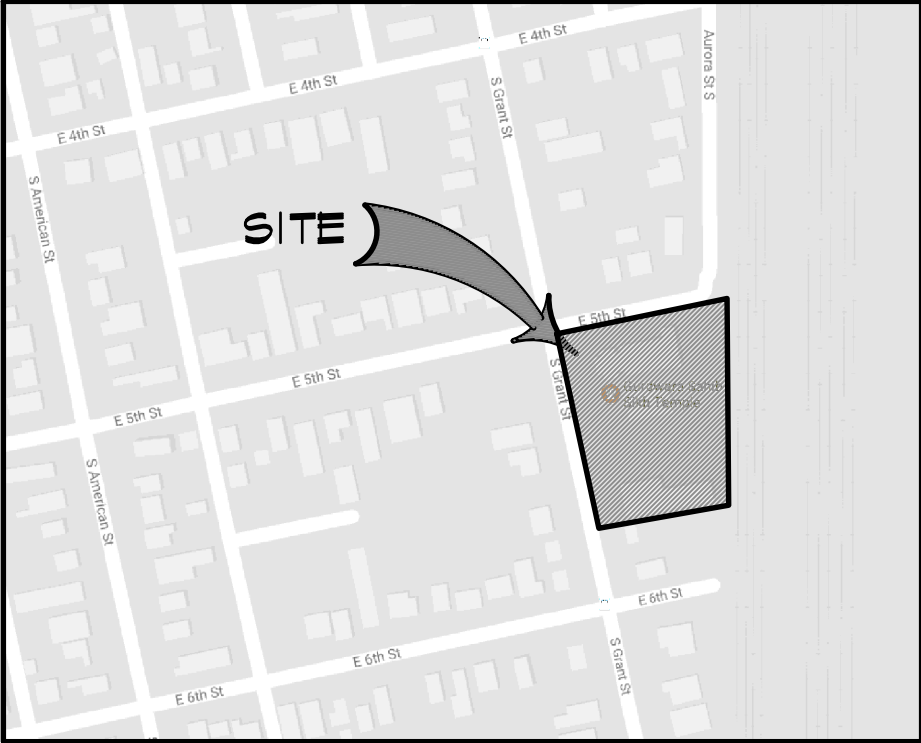

PROPOSED PHASE II ROOF COVER FOR: SIKHI TEMPLE 1930 SIKH TEMPLE ST. STOCKTON, CA 95206

PROJECT DATA:

PROJECT OWNER GUARDWARA SAHIB
SIKH TEMPLE
1930 SIKH TEMPLE ST.
STOCKTON, CA 95206

PROJECT LOCATION 1930 SIKH TEMPLE ST.
STOCKTON, CA 95206

APN 167-200-53

ZONING RL

PROJECT DESCRIPTION ROOF COVER FOR
DINING

OCCUPANCY A2

CONSTRUCTION TYPE II B

FIRE SPRINKLERS YES

OCCUPANT LOAD 383 OCCUPANTS

AREAS:

(E) TEMPLE 5,408 S.F.

(E) LIBRARY 2,343 S.F.

(E) KITCHEN / DINING BLDG 6,135 S.F.

EXISTING ROOF COVER 5,986 S.F.

PROPOSED ROOF COVER 1,968 S.F.

TOTAL AREA 21,840 S.F.

SHEET INDEX:

CS COVER SHEET, SITE PLAN &
PROJECT DATA

AI PROPOSED FLOOR PLAN &
EXTERIOR ELEVATION

SI FOUNDATION PLANS, DETAILS, &
GENERAL NOTES

GB1 GREEN BUILDING STANDARDS

GB2 GREEN BUILDING STANDARDS

GB3 GREEN BUILDING STANDARDS

CODE COMPLIANCE

ALL WORK PERFORMED SHALL BE IN ACCORDANCE TO THE LATEST EDITION OF APPLICABLE CODES, INCLUDING BUT NOT LIMITED TO:

- 2025 CALIFORNIA BUILDING CODE, (CBC)
- 2025 CALIFORNIA ELECTRICAL CODE, (CEC)
- 2025 CALIFORNIA GREEN BUILDING CODE, (CGBC)
- 2025 CALIFORNIA MECHANICAL CODE, (CMC)
- 2025 CALIFORNIA PLUMBING CODE, (CPC)
- 2025 CALIFORNIA ENERGY CODE, (CEC)
- 2025 CALIFORNIA FIRE CODE, (CFC)
- 2025 CALIFORNIA HISTORICAL BUILDING CODE
- 2025 CALIFORNIA EXISTING BUILDING CODE
- 2025 CALIFORNIA REFERENCED STANDARDS CODE

OCCUPANT LOAD CALCULATION					
SPACE:	SIZE (S.F.):	OCCUPANT LOAD FACTOR:		TOTAL OCCUPANT LOAD:	
		CBC	CFC	CBC	CFC
(E) ROOF COVER	5744 S.F.	15	30	383	191
(N) ROOF COVER	1968 S.F.	15	30	131	66
TOTAL OCCUPANT LOAD				514	257

MINIMUM PLUMBING FIXTURES PER CPC TABLE 422.1

FOR A2 OCCUPANCY, 129 MEN & 129 WOMEN					
FIXTURES REQ'D:			FIXTURES PROVIDED		
MEN:	WATER CLOSET	2	MEN:	WATER CLOSET	5
	URINAL	1		URINAL	5
	LAVATORY	1		LAVATORY	4
WOMEN:	WATER CLOSETS	4	WOMEN:	WATER CLOSETS	11
	LAVATORY	1		LAVATORY	4


- NOTES:
1. PROVIDE SPECIAL INSPECTION AS FOLLOWS
a) HIGH STRENGTH BOLTING PERIODIC
b) SUBGRADE PREP PER SOILS REPORT PERIODIC
 2. EXISTING HISTORICAL BUILDINGS, TEMPLE & LIBRARY DO NOT HAVE FIRE SPRINKLER SYSTEM. NEW ROOF CANOPY SHALL HAVE FIRE SPRINKLERS. ALTERNATE MEANS & METHODS REQUEST REQUIRED DUE TO INABILITY TO MODIFY EXISTING BUILDINGS. FIRE AREA SEPARATIONS CAN NOT BE PROVIDED.
 3. FOUNDATION DESIGN BASED UPON SOILS REPORT BY "CTE CAL INC." JOB NO. 25-1T326, DATED 5-8-25. ALLOWABLE SOIL BEARING PRESSURE = 2.0 KSF

SCOPE OF WORK:


1. ENTRY ROOF COVER ADDITION TO EXISTING ROOF COVER.

DEFERRED SUBMITTALS:

1. FIRE SPRINKLER AND FIRE ALARM SYSTEMS.

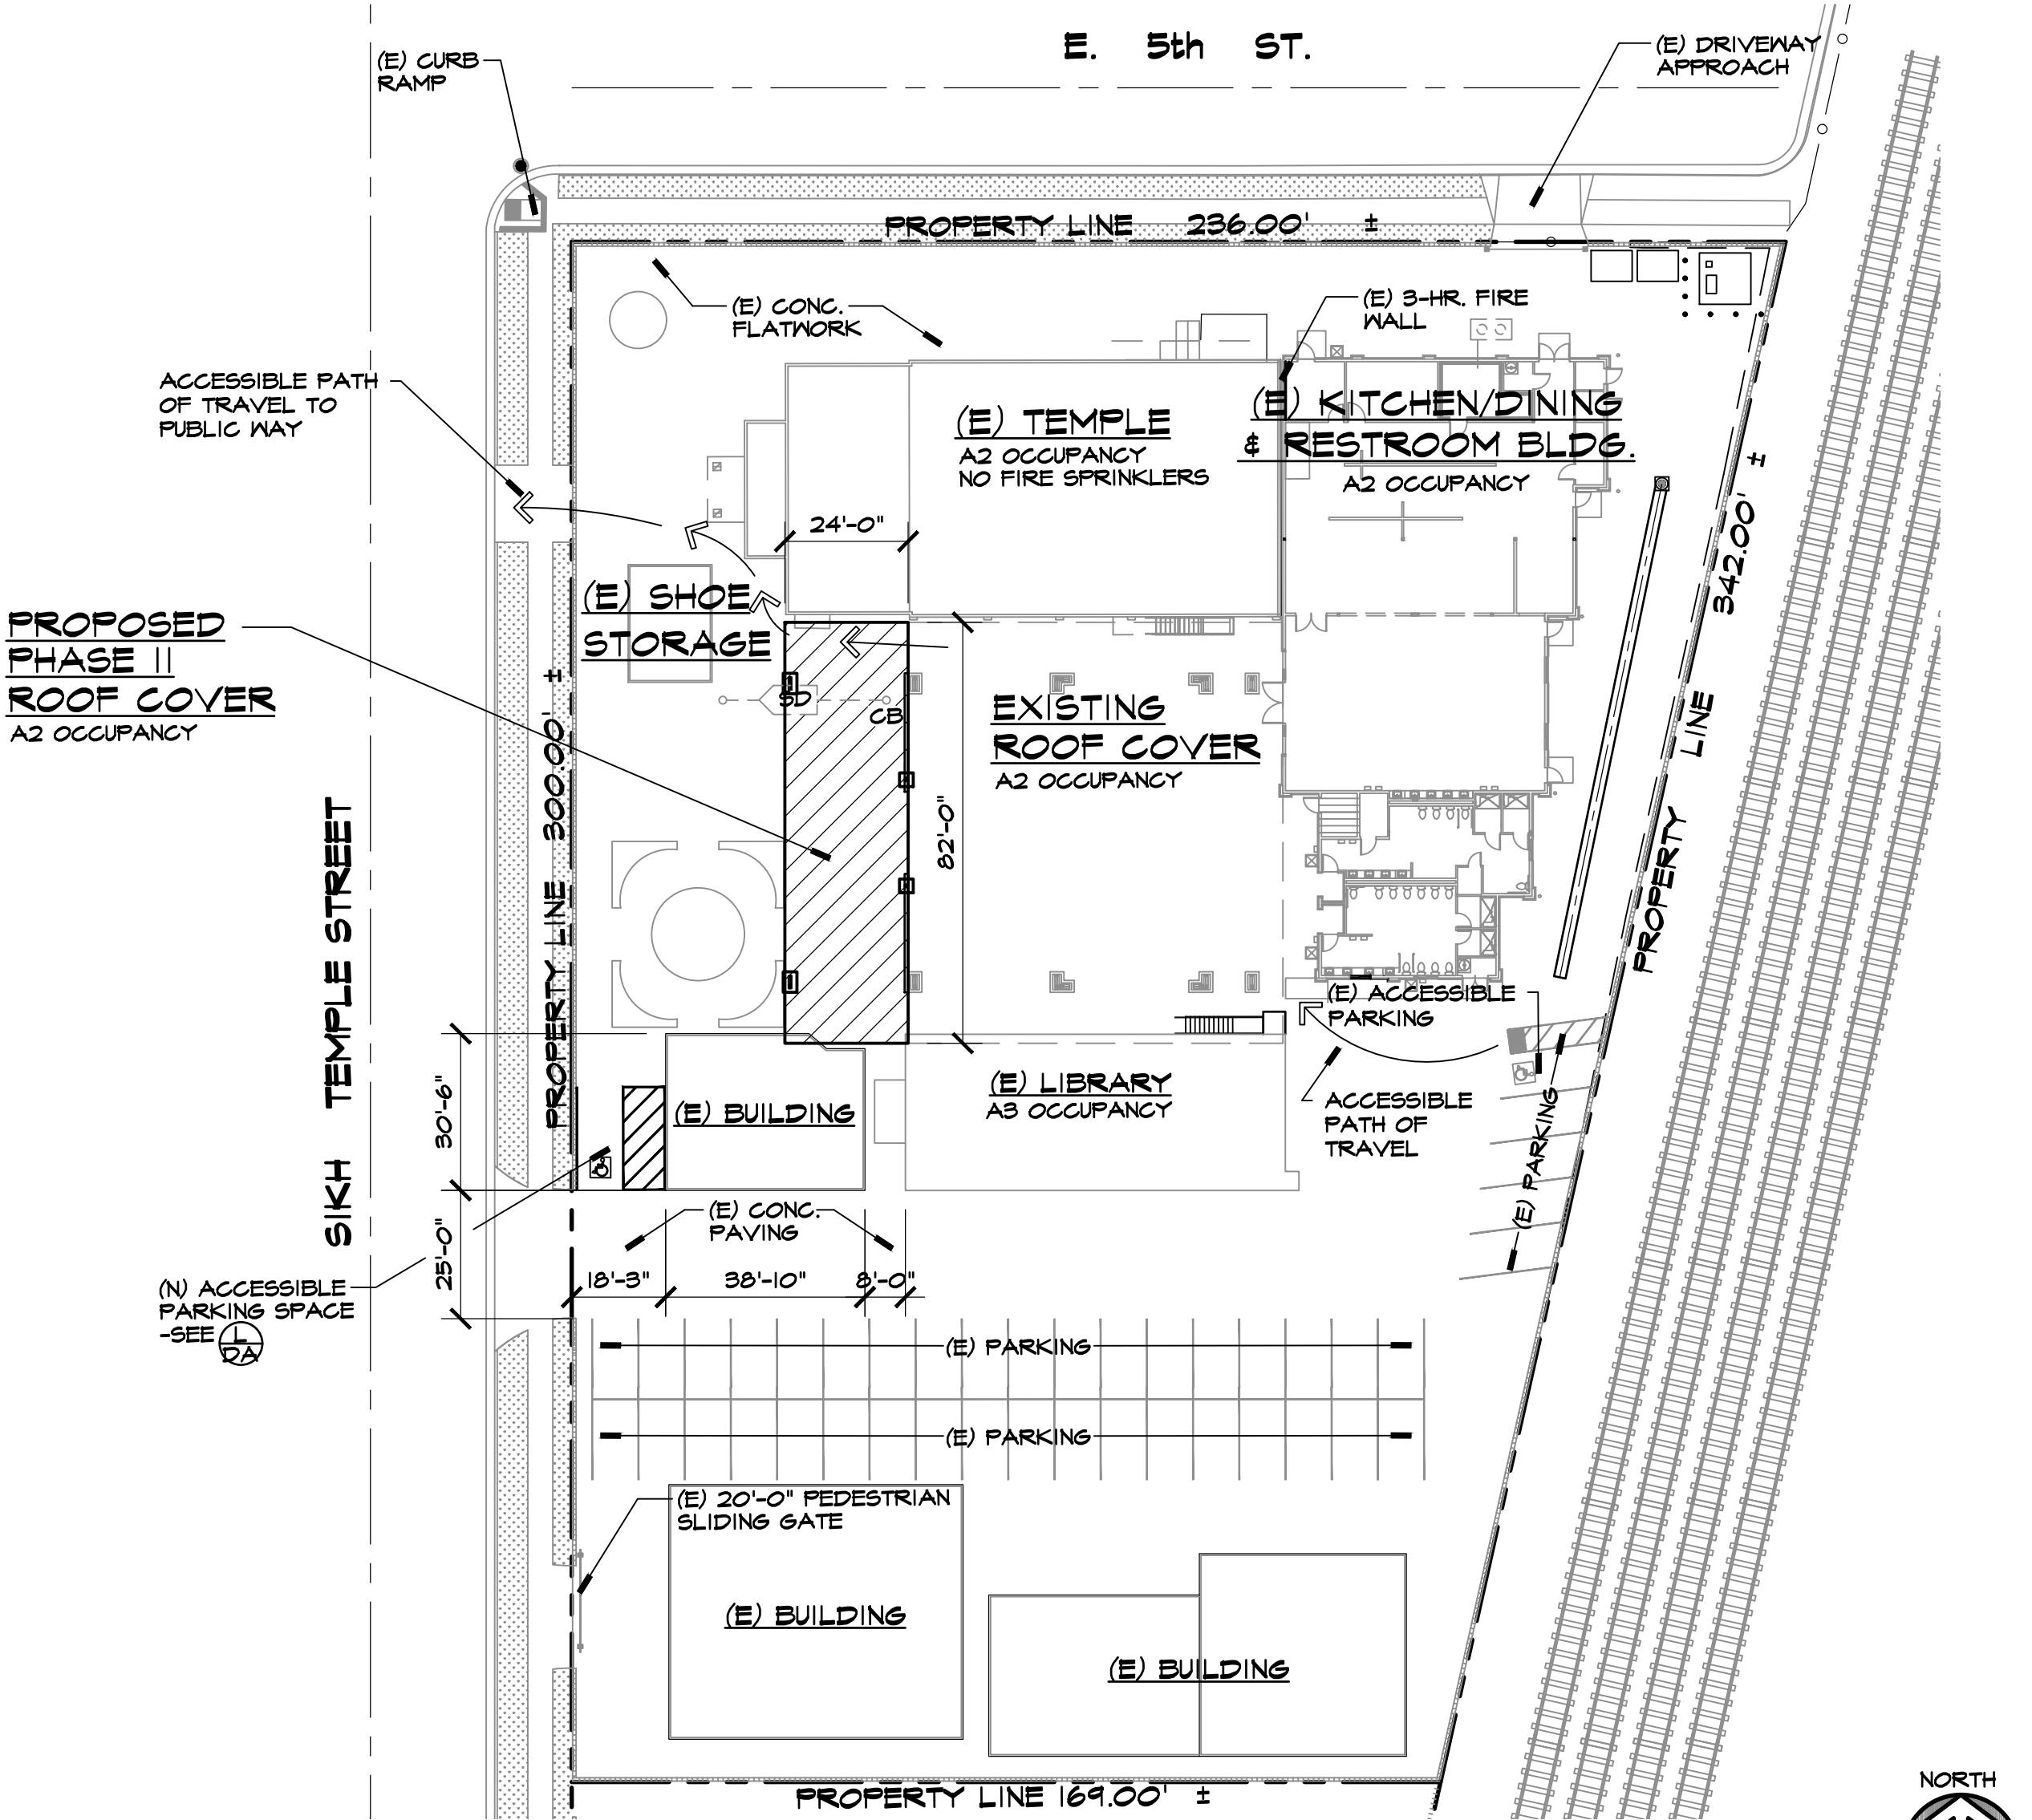


PROPOSED SITE PLAN



REVISIONS	BY

MIKE SMITH
ENGINEERING, INC.
4 NORTH MAIN STREET
LODI, CALIFORNIA 95240
PHONE (209) 334-2332

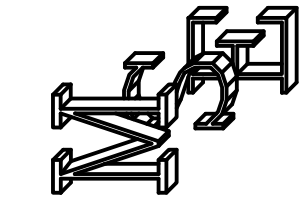


TITLE:
COVER SHEET
PROJECT DATA
SITE PLAN
SHEET INDEX

PROJECT:
PROPOSED ROOF COVER FOR:
SIKH TEMPLE
PROJECT LOCATION:
1930 SIKH TEMPLE ST.
STOCKTON, CA 95206




DRAWN
JCS
CHECKED
MS
DATE
2/21/24
SCALE
AS NOTED
JOB NO.
23314

SHEET
PHASE II
CS
1 OF 7 SHEETS

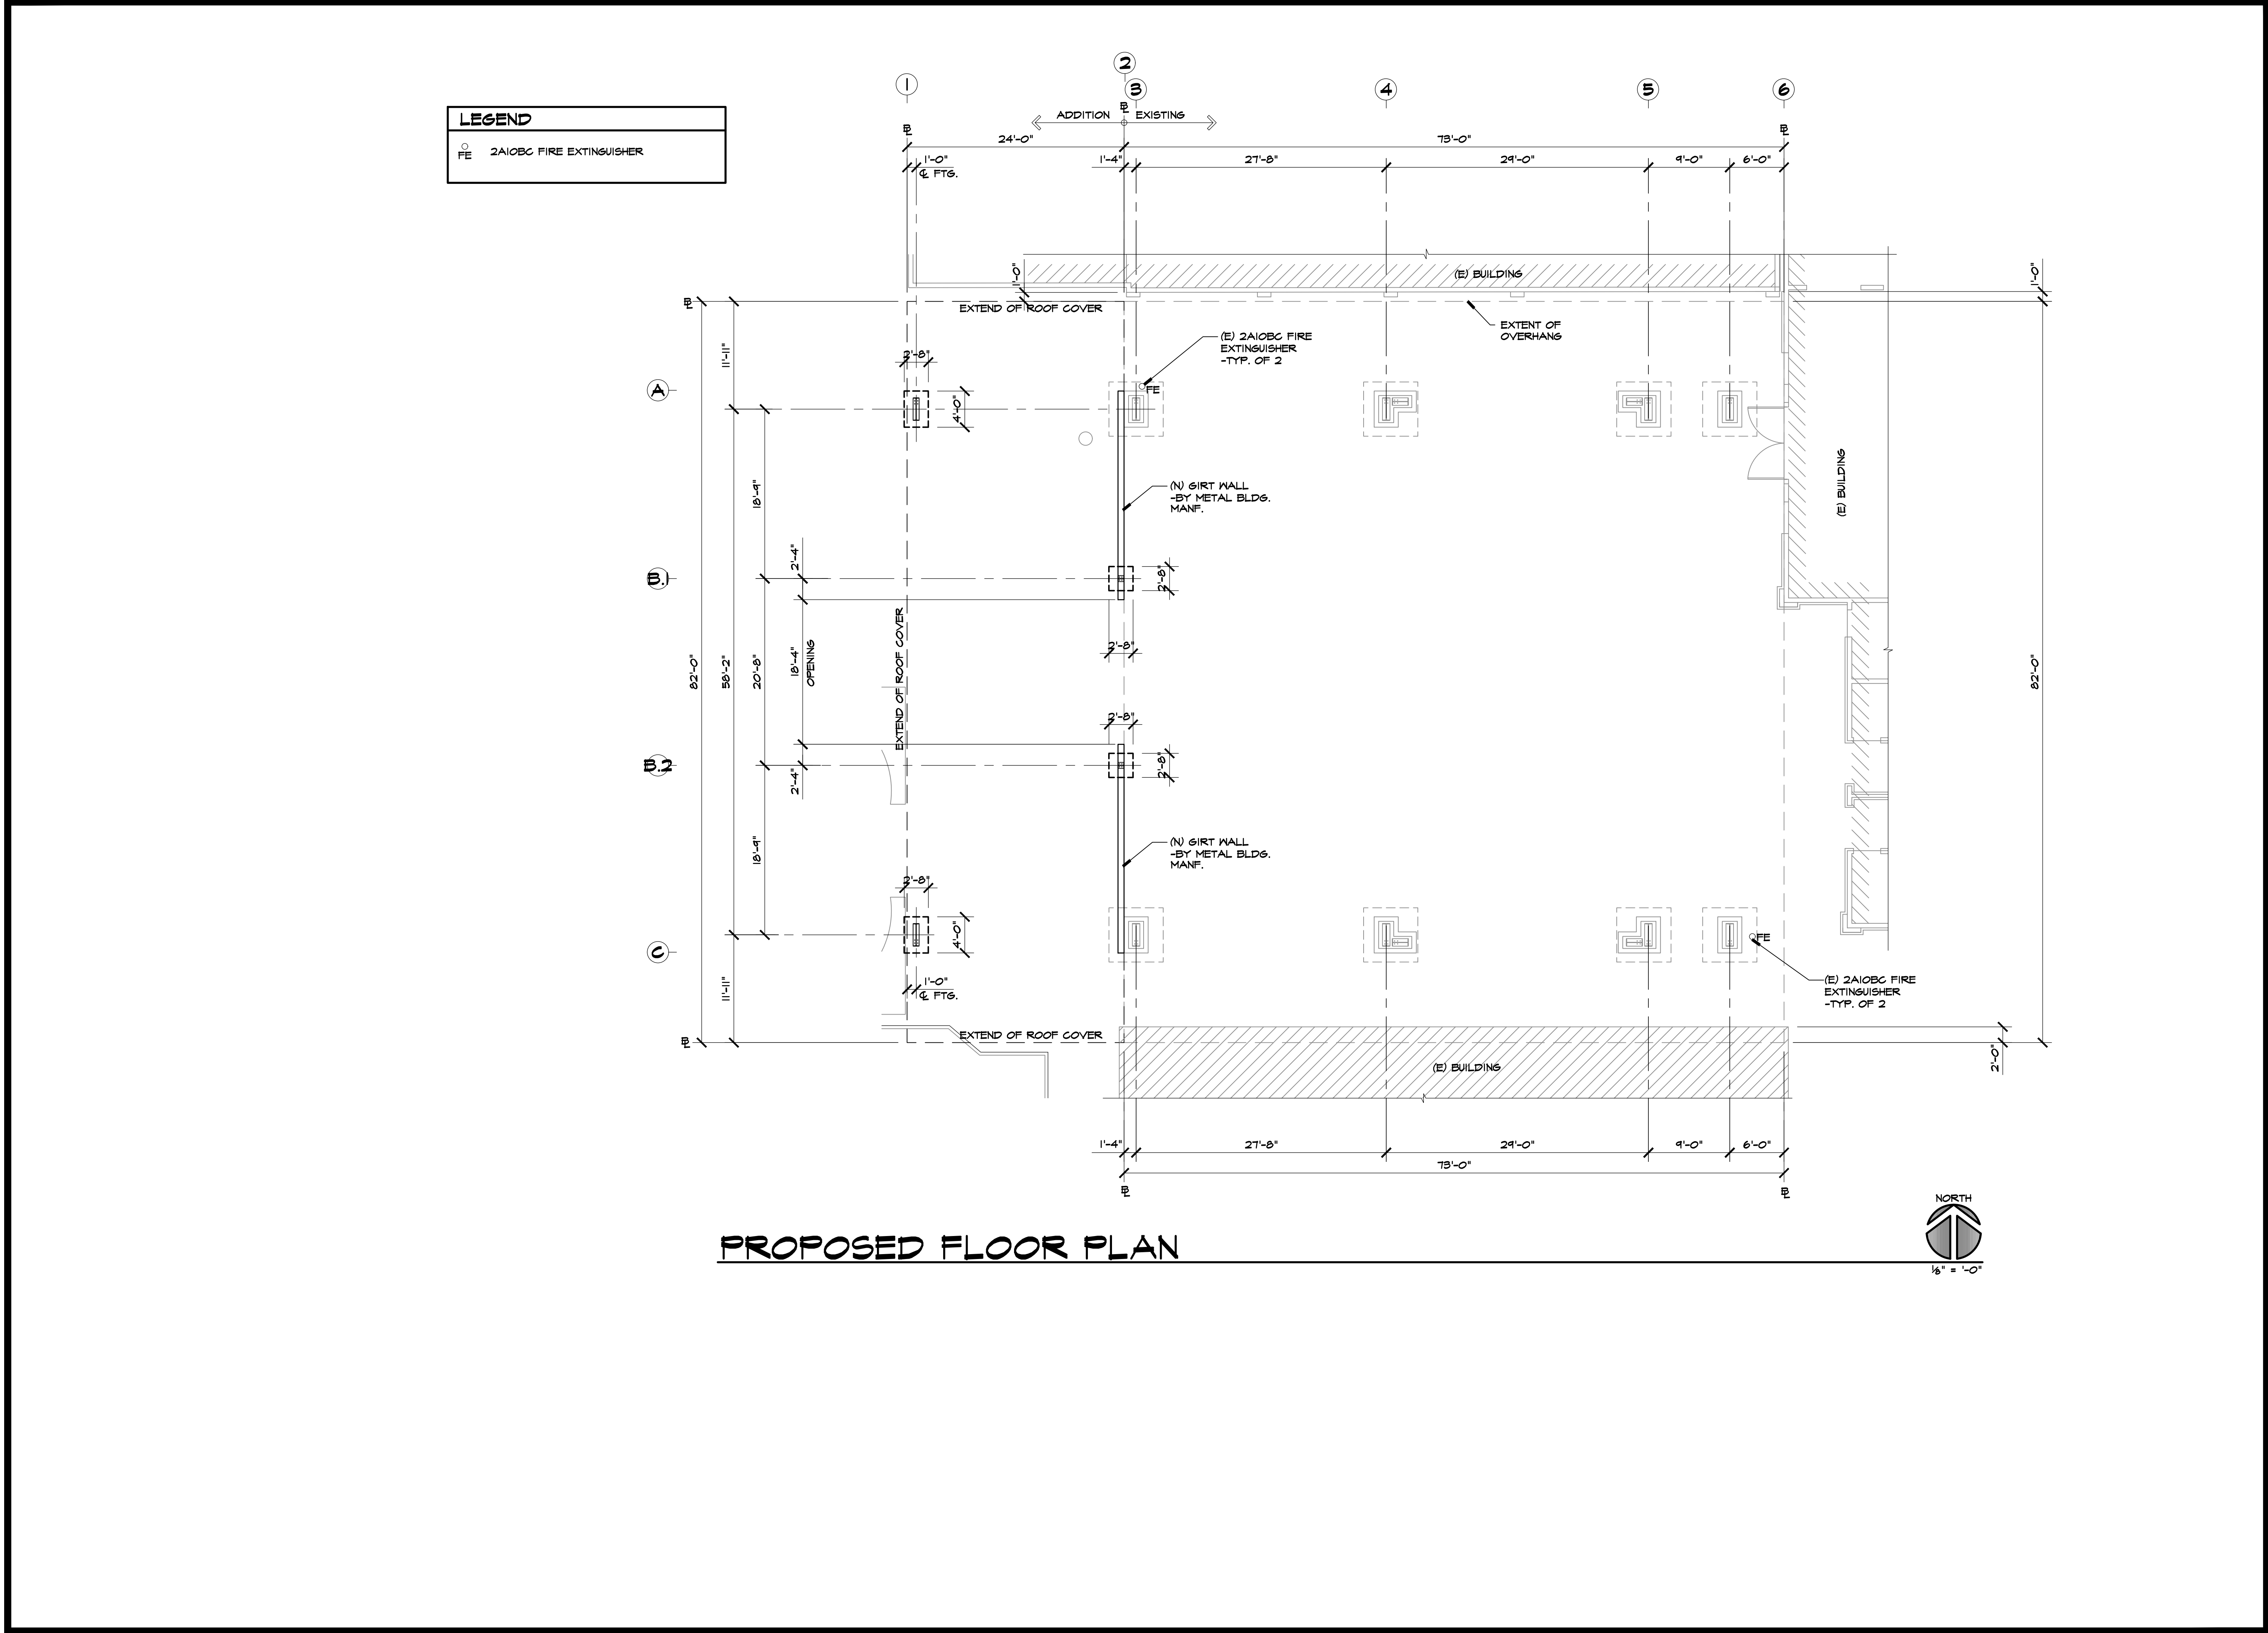

REVISIONS	BY

MIKE SMITH
ENGINEERING, INC.
4 NORTH MAIN STREET
LODI, CALIFORNIA 95240
PHONE (209) 334-2332



TITLE:
PROPOSED FLOOR PLAN


PROJECT:
PROPOSED ROOF COVER FOR:
Sikh Temple
PROJECT LOCATION:
1950 SIKH TEMPLE ST.
STOCKTON, CA 95206



THESE PLANS ARE PRELIMINARY
AND NOT FOR CONSTRUCTION
UNLESS THERE IS A WET SIGNED
SIGNATURE UPON STAMP


DRAWN JCS
CHECKED MS
DATE 2/21/24
SCALE AS NOTED
JOB NO. 25314

SHEET
PHASE II
A1
2 OF 7 SHEETS

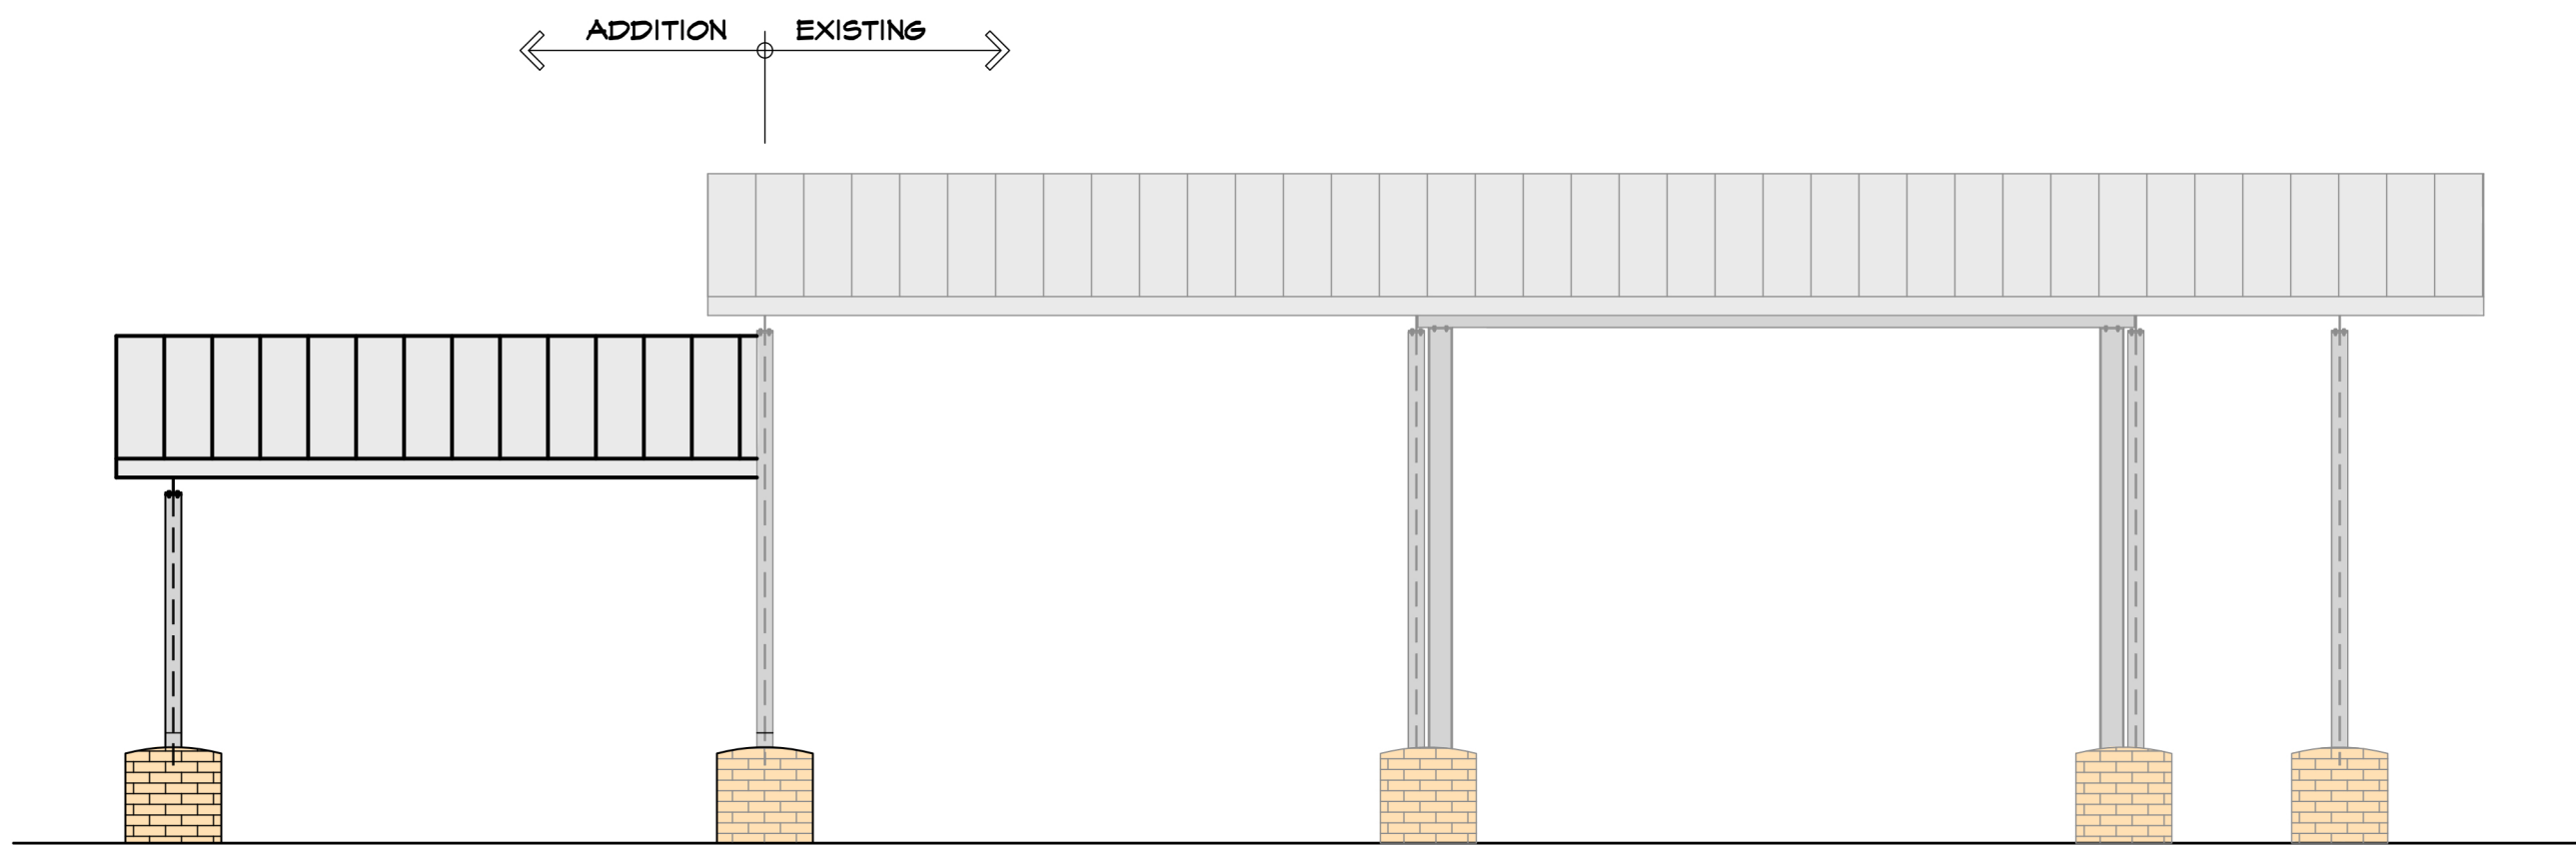

NORTH & SOUTH EXT. ELEVATION

1/8" = 1'-0"

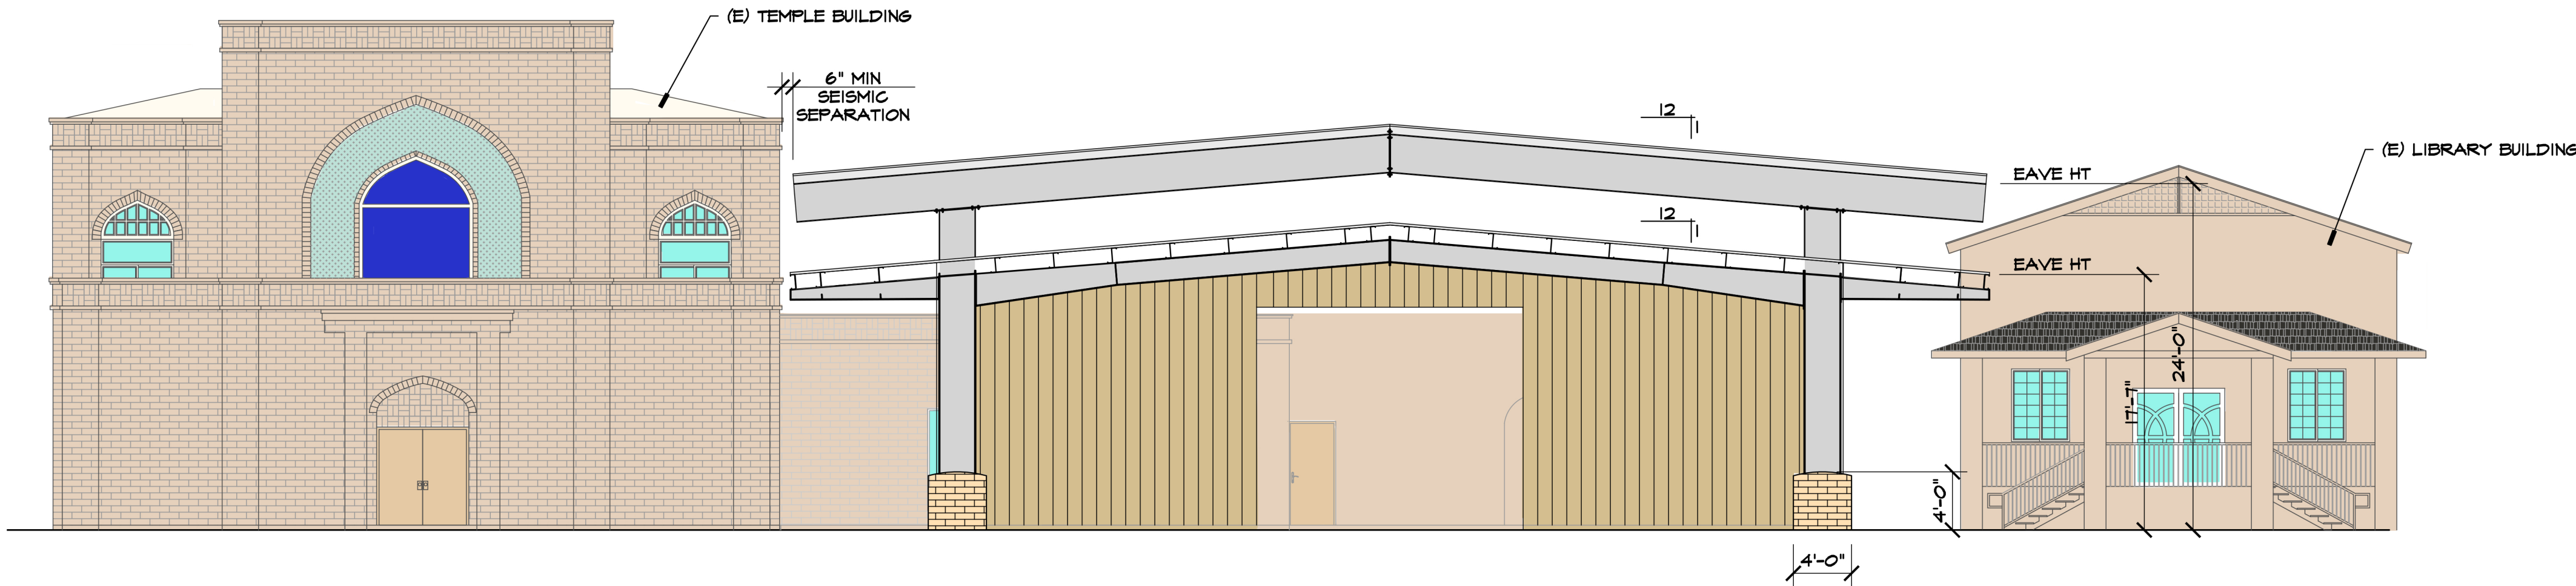

WEST ELEVATION

1/8" = 1'-0"

REVISIONS	BY

MIKE SMITH
ENGINEERING, INC.
4 NORTH MAIN STREET
LODI, CALIFORNIA 95240
PHONE (209) 334-2332

TITLE:
EXTERIOR ELEVATIONS

PROJECT:
PROPOSED ROOF COVER FOR:
SIKH TEMPLE
PROJECT LOCATION:
1950 SIKH TEMPLE ST.
STOCKTON, CA 95206


STAMP
REGISTERED PROFESSIONAL ENGINEER
MICHAEL W. SMITH
NO. 0044580
EXP. 3-31-26
CIVIL
STATE OF CALIFORNIA

ELECTRONICALLY SIGNED
02/19/2026 1:18:08 PM


DRAWN
JCS
CHECKED
MS
DATE
2/21/24
SCALE
AS NOTED
JOB NO.
25514
SHEET
PHASE II
A 2
2 OF 7 SHEETS

GENERAL NOTES

- I. GENERAL**
- A. ALL WORK SHALL BE IN STRICT ACCORDANCE WITH THE 2022 EDITION OF THE CALIFORNIA BUILDING CODE AND STANDARDS AND ALL PUBLICATIONS NOTED HEREIN.
- B. DETAILS SHOWN ON THE STRUCTURAL DRAWINGS ARE TYPICAL AND SIMILAR. SPECIFIC NOTES AND DETAILS SHOWN ON THE DRAWINGS TAKE PRECEDENCE OVER GENERAL NOTES AND TYPICAL DETAILS.
- C. DIMENSIONS SHOWN SHALL TAKE PRECEDENCE OVER SCALE ON THE PLANS, SECTIONS AND DETAILS. ANY DISCREPANCIES SHALL BE BROUGHT TO THE IMMEDIATE ATTENTION OF THE ENGINEER.
- D. ALL CONSTRUCTION MATERIALS SHALL BE SPREAD OUT IF PLACED ON FLOOR OR ROOF FRAMING MEMBERS. LOADS FROM SUCH MATERIALS SHALL NOT EXCEED DESIGN LIVE LOADS.
- E. REVIEW THE SHOP DRAWINGS BY THE ENGINEER. FOR GENERAL COMPLIANCE WITH DRAWINGS AND SPECIFICATIONS, THE CONTRACTOR SHALL REMAIN RESPONSIBLE FOR ALL ERRORS OF DETAILING, FABRICATION AND THE CORRECT FITTING OF STRUCTURAL MEMBERS, INCLUDING COORDINATION WITH OTHER TRADES.
- F. ALL DETAIL CHANGES DESIRED SHALL BE SUBMITTED TO THE ENGINEER IN WRITING. SHOP DRAWINGS DO NOT CONSTITUTE CHANGES IN WRITING. ALONG WITH A LETTER, THE SHOP DRAWINGS SHALL SHOW ALL PROPOSED CHANGES.
- G. DESIGN LOADS ARE AS PER CHAPTER 16 OF THE CBC AND MAY BE MODIFIED AS PER THESE NOTES.
- 2. FOUNDATIONS**
- REFERS TO SOILS REPORT BY "CITE CAL, INC." JOB NO. 25-11326 DATED 5-8-25.
- 3. CONCRETE**
- A. GENERAL - ALL CONCRETE WORK SHALL BE PERFORMED IN ACCORDANCE WITH ACI AND CHAPTER 19 OF THE CBC CODES.
- B. CONCRETE - STRENGTH - UNLESS OTHERWISE NOTED ON THE PLANS, CONCRETE SHALL OBTAIN A MIN. 28 DAY STRENGTH OF 3,000 PSI FOR SLABS, SPREAD FOOTINGS AND WALLS.
- C. MATERIALS - MIN. 5 SACKS PER YARD.
- D. AGGREGATES - MAXIMUM SIZE 1/2".
- E. WATER/CEMENT RATIO - 0.35 MAXIMUM.
- F. SLUMP - 4" MAXIMUM.
- G. ADMIXTURES - ONLY AS APPROVED BY THE ENGINEER.
- H. CURING - KEEP WET MIN. 3 DAYS, OR UNTIL MEMBRANE CURING COMPOUND APPROVED BY THE ENGINEER.
- I. VIBRATION - ALL CONCRETE SHALL BE VIBRATED INTO PLACE W/ A MECHANICAL VIBRATOR.
- J. FORM REMOVAL - SIDE FORMS OF FOUNDATIONS AND SLABS - MIN. 2 DAYS.
- K. TESTING - IN ACCORDANCE WITH ACI-301-12, CHAPTER 19.
- L. CONTRACTOR SHALL VERIFY A MAXIMUM MOISTURE VAPOR EMISSION RATE OF 3 LB/1,000 S.F. BEFORE FLOOR COVERING CAN BE PLACED.
- 4. REINFORCING MATERIALS**
- A. DEFORMED BARS - ASTM A615, #4 AND SMALLER, GRADE 40; #5 AND LARGER, GRADE 60.
- B. ELECTRIC WELDED KIRK FABRIC (EWF) - ASTM A 105.
- C. LAP SPICE OF REINFORCEMENT IN TENSION SHALL BE 40 BAR DIAMETERS MINIMUM.
- 5. MASONRY**
- A. GENERAL - ALL MASONRY WORK SHALL BE PERFORMED IN ACCORDANCE WITH ACI, CBC AND CMA.
- B. CONCRETE MASONRY UNITS (CMU) - 14" x 12" x 8" COMPRESSIVE STRENGTH OF UNITS = 1,500 PSI, GRADE N AS PER ASTM C225 OR ASTM C400 W/ MAX 60% SHRINKAGE PER CMA STANDARDS.
- C. MORTAR - TYPE S.
- D. COMPOSITION - ASTM C270-1 PART PORTLAND CEMENT, 1/2 PART MAXIMUM LINE PUTTY OR HYDRATED LIME, DAMP LOOSE SAND NOT LESS THAN 2-1/4, NO MORE THAN 3 TIMES THE SUM OF THE CEMENT AND LIME USED.
- E. GROUT.
- F. AGGREGATE - MAXIMUM AGGREGATE SIZE 3/4".
- G. CEMENT - MIN. CEMENT 6 SACKS PER YARD.
- H. MIX STRENGTH.
- I. MINIMUM 7 DAY STRENGTH = 1,250 PSI.
- J. MINIMUM 28 DAY STRENGTH = 2,000 PSI.
- K. GROUT CELLS AS SHOWN ON THE PLANS WITH LOW LIFT PROCEDURES. CMU SHALL BE DRY AND CLEAN BEFORE GROUTING.
- L. MATERIALS.
- M. PORTLAND CEMENT - ASTM C150, TYPE I OR II - LOW ALKALI.
- N. AGGREGATE - MORTAR SAND ASTM C144 - OR GROUT SAND ASTM C404.
- O. HYDRATED LIME - ASTM C207, TYPE S.
- P. ADMIXTURES - ONLY AS APPROVED BY ENGINEER.
- Q. REINFORCING MATERIALS.
- R. DEFORMED BARS - ASTM A615, #4 AND SMALLER, GRADE 40; #5 AND LARGER, GRADE 60.
- 6. STRUCTURAL STEEL & MISCELLANEOUS IRON**
- A. CODES - ALL WORK SHALL CONFORM TO THE LATEST EDITION OF THE FOLLOWING CODES.
- B. AISC - AMERICAN INSTITUTE OF STEEL CONSTRUCTION.
- C. AWS - AMERICAN WELDING SOCIETY STANDARD CODE D1.1.
- D. ASTM - AMERICAN SOCIETY OF TESTING MATERIALS.
- E. MATERIALS.
- F. STRUCTURAL STEEL MEMBERS - ASTM A-36 & A992 OR AS SHOWN ON THE PLANS.
- G. STRUCTURAL TUBING - ASTM A500 GRADE B.
- H. STRUCTURAL PIPING - ASTM A53 GRADE B.
- I. COMMON BOLTS - ASTM A307 GRADE A (UNLESS NOTED ON THE PLANS AS HIGH).
- J. WASHERS - ASTM F436.
- K. NUTS - ASTM A563.
- L. ANCHOR RODS (BOLTS) - ASTM F1554 GRADE 36.
- M. HIGH STRENGTH BOLTS, NUTS AND WASHERS - ASTM A325 (INDICATED ON DRAWINGS AS HIGH).
- N. WELDING MATERIALS - E-70 ELECTRODES AS PER AWS-D1.1.
- O. PAINT PRIMER - FED. SPEC. TT-D31, RED OXIDE.
- P. GALVANIZING - ASTM A525 MIN. 207 HOT DIPPED.
- Q. OPEN WEB STEEL JOISTS - AS NOTED ON THE PLANS - PER STANDARD SPECIFICATIONS OF THE STEEL JOIST INSTITUTE.
- R. METAL DECKING - ASTM A446 GRADE D (75" x 50" x 5/8) - GALV. TO ASTM A525 6-60 COATING. FABRICATION AS PER STEEL DECK INSTITUTE SPECIFICATIONS.
- S. FABRICATION.
- T. WELDING - WELDING SHALL BE PERFORMED BY CERTIFIED WELDERS ONLY.
- U. SHOP FABRICATE TO THE GREATEST POSSIBLE EXTENT.
- V. SHOP PRIME ALL STEEL EXCEPT GALVANIZED STEEL. DO NOT PRIME SURFACES TO BE WELDED OR WHICH WILL BE PLACED INTO CONCRETE.
- W. SHOP DRAWINGS.
- X. SHOP DRAWINGS SHALL BE SUBMITTED FOR ALL STRUCTURAL STEEL MEMBERS.
- Y. COORDINATE SHOP DRAWINGS WITH ALL OTHER TRADES.
- Z. TESTING AND INSPECTION.
- AA. SPECIAL INSPECTIONS ARE ONLY REQUIRED IF NOTED ON THE COVER SHEET AND SHALL CONFORM TO THE FOLLOWING.
- AB. STRUCTURAL STEEL - SUBMIT MILL REPORTS AS PER AISC SPECIFICATIONS.
- AC. HIGH STRENGTH BOLTS, BOLTS AND WASHERS - PROVIDE WRITTEN MILL CERTIFICATES.
- AD. ALL FIELD WELDING SHALL BE BY A CERTIFIED WELDER AND INSPECTED BY AN APPROVED WELDING INSPECTOR.
- AE. HIGH STRENGTH BOLTS SHALL BE INSPECTED BY A QUALIFIED INSPECTOR APPROVED BY THE ENGINEER.

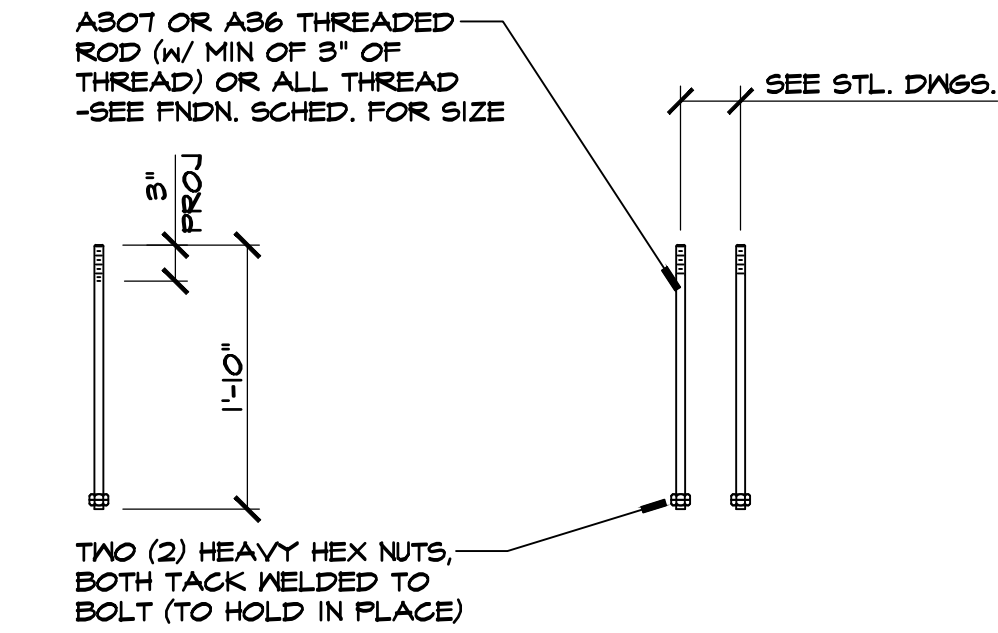


TYP. A.B. DETAIL

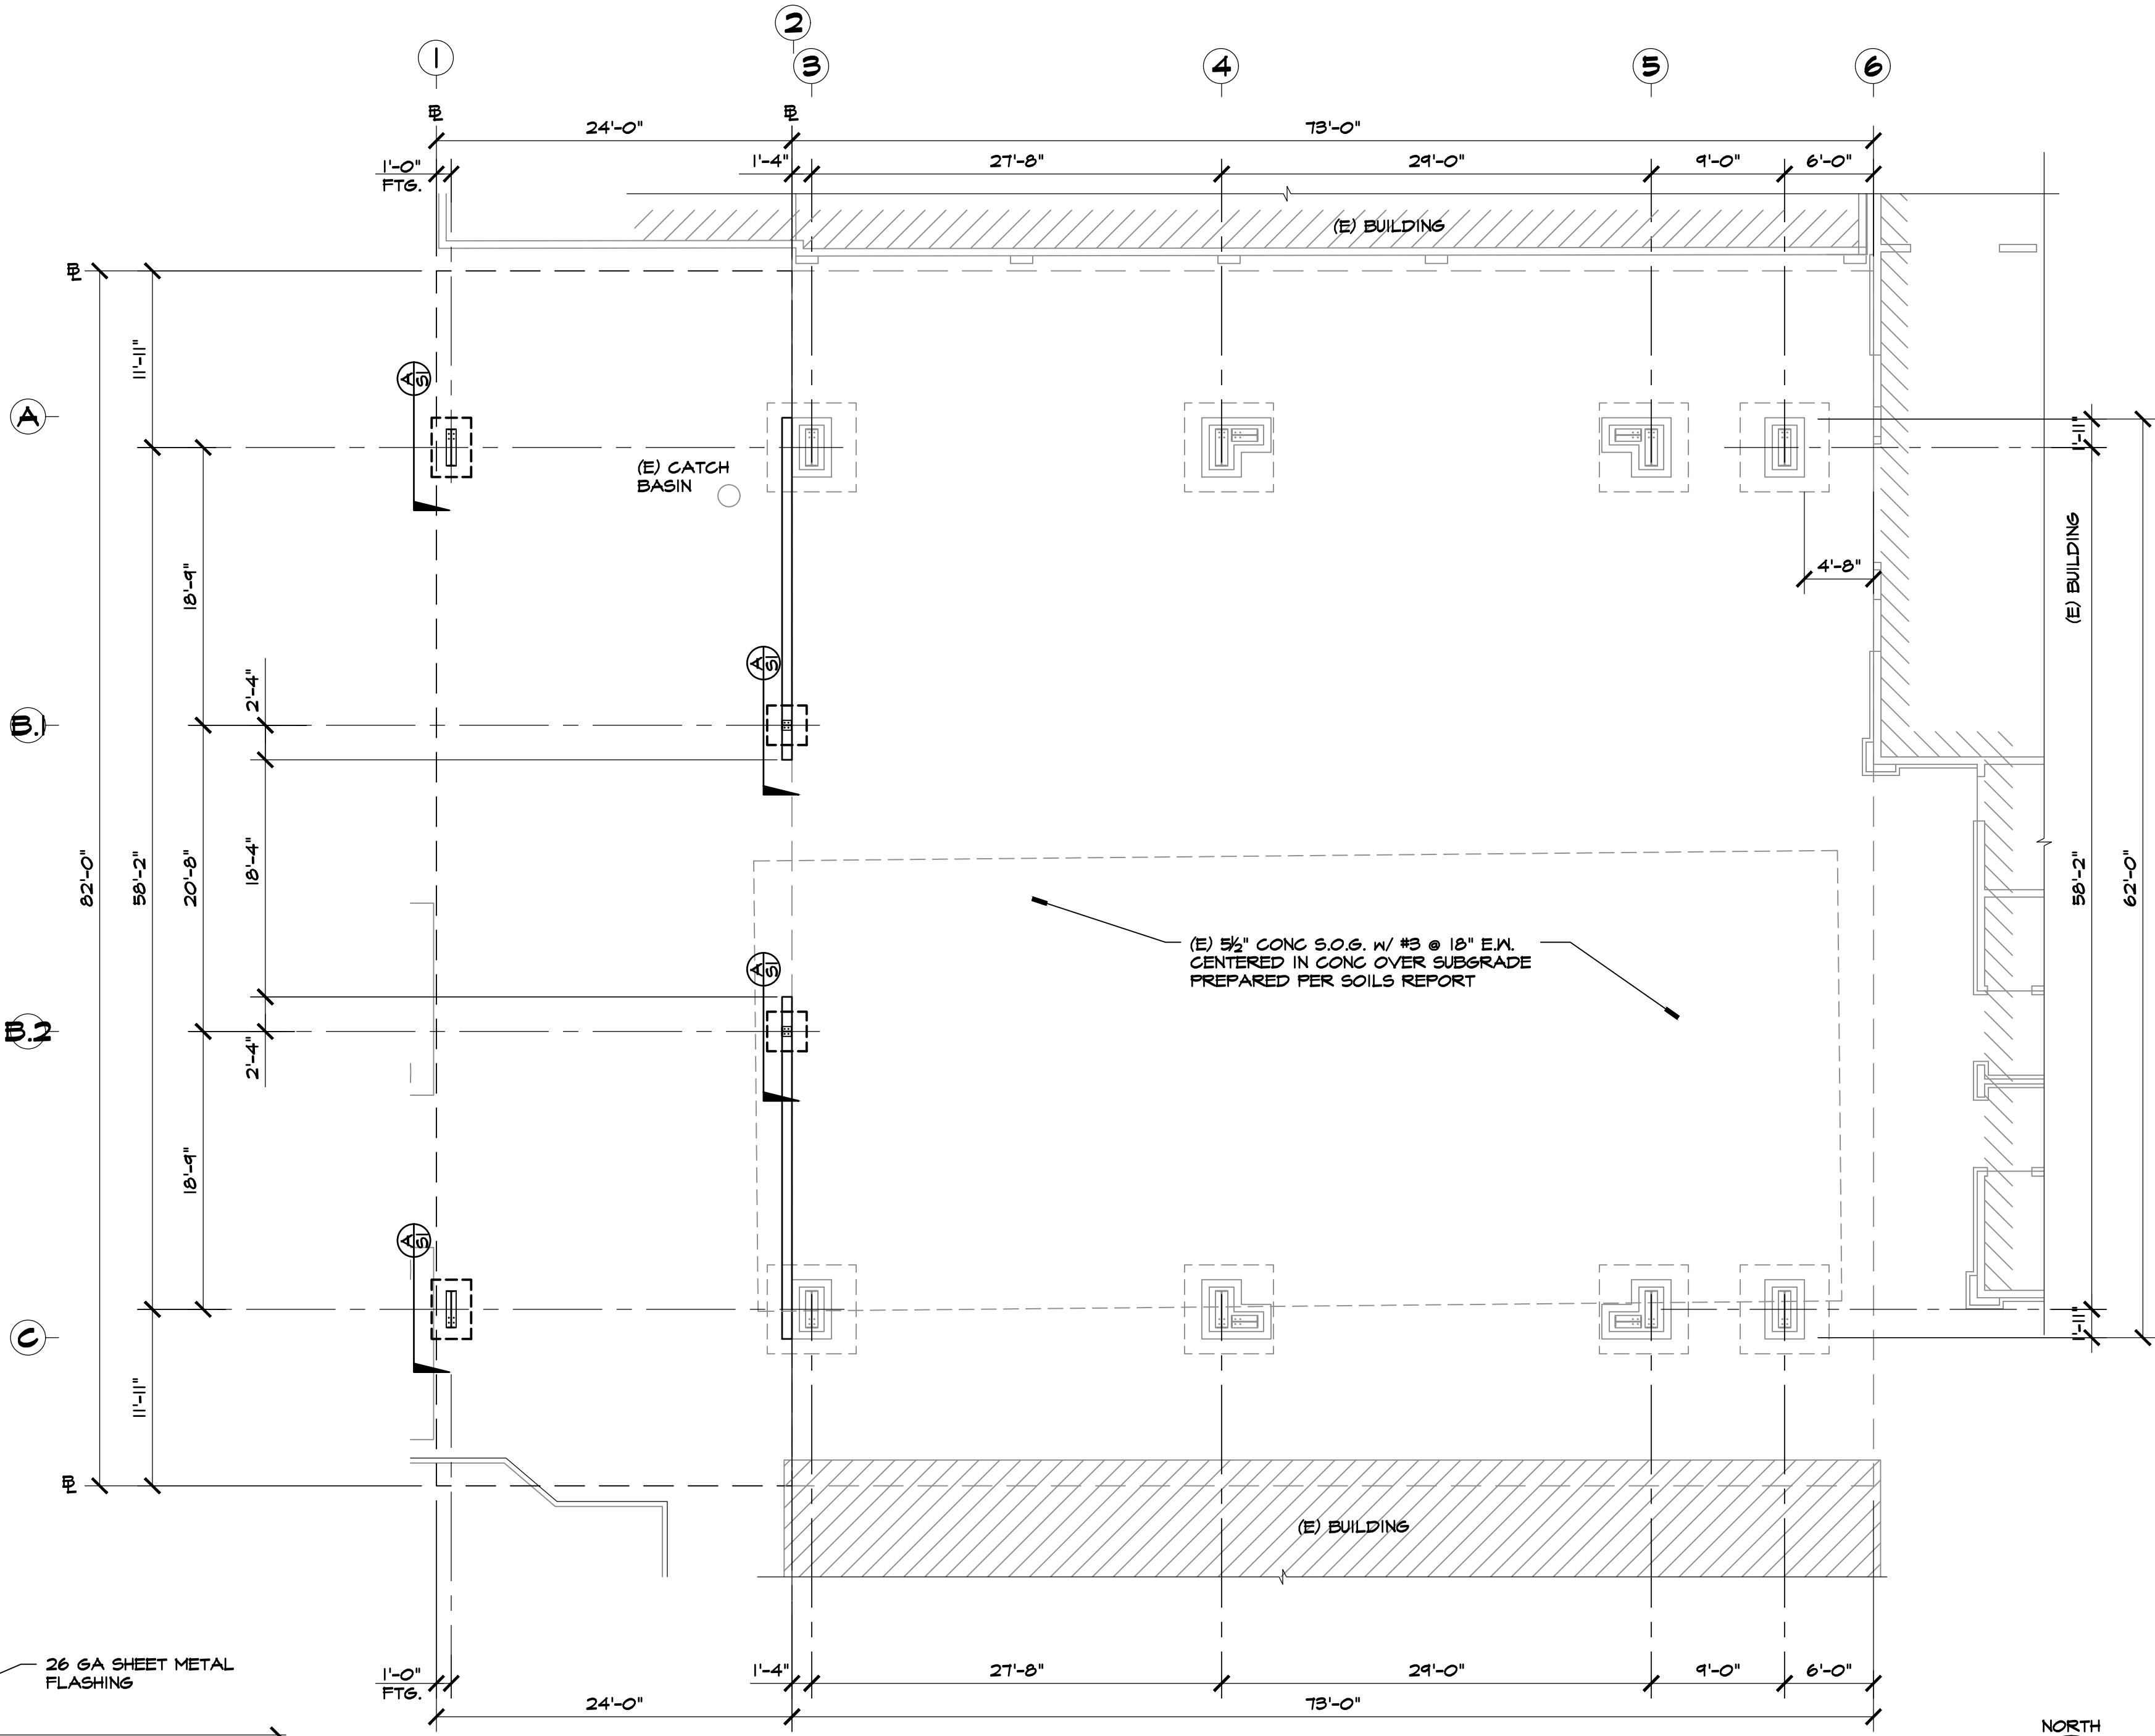

FOUNDATION PLAN

LOCATION	SIZE			REINF. (# BOT.)	ANCHOR BOLTS F1554 ASTM	NOTES	DETAIL REF.
	WIDTH	LENGTH	DEPTH				
A1, C1	3'-6"	3'-6"	1'-6"	4-#4 E.W. @ BOT	3/4" x 1'-6" A.B. w/ 3" PROJ. (4) REQ'D		(A) S1
B1-1 B.2-1	2'-6"	2'-6"	1'-6"	3-#4 E.W. @ BOT	3/4" x 1'-6" A.B. w/ 3" PROJ. (4) REQ'D		(A) S1

NOTE:
FOUNDATION DESIGN BASED UPON SOILS REPORT BY "CITE CAL, INC." JOB NO. 25-11326, DATED 5-8-25. ALLOWABLE SOIL BEARING PRESSURE = 2.0 KSF

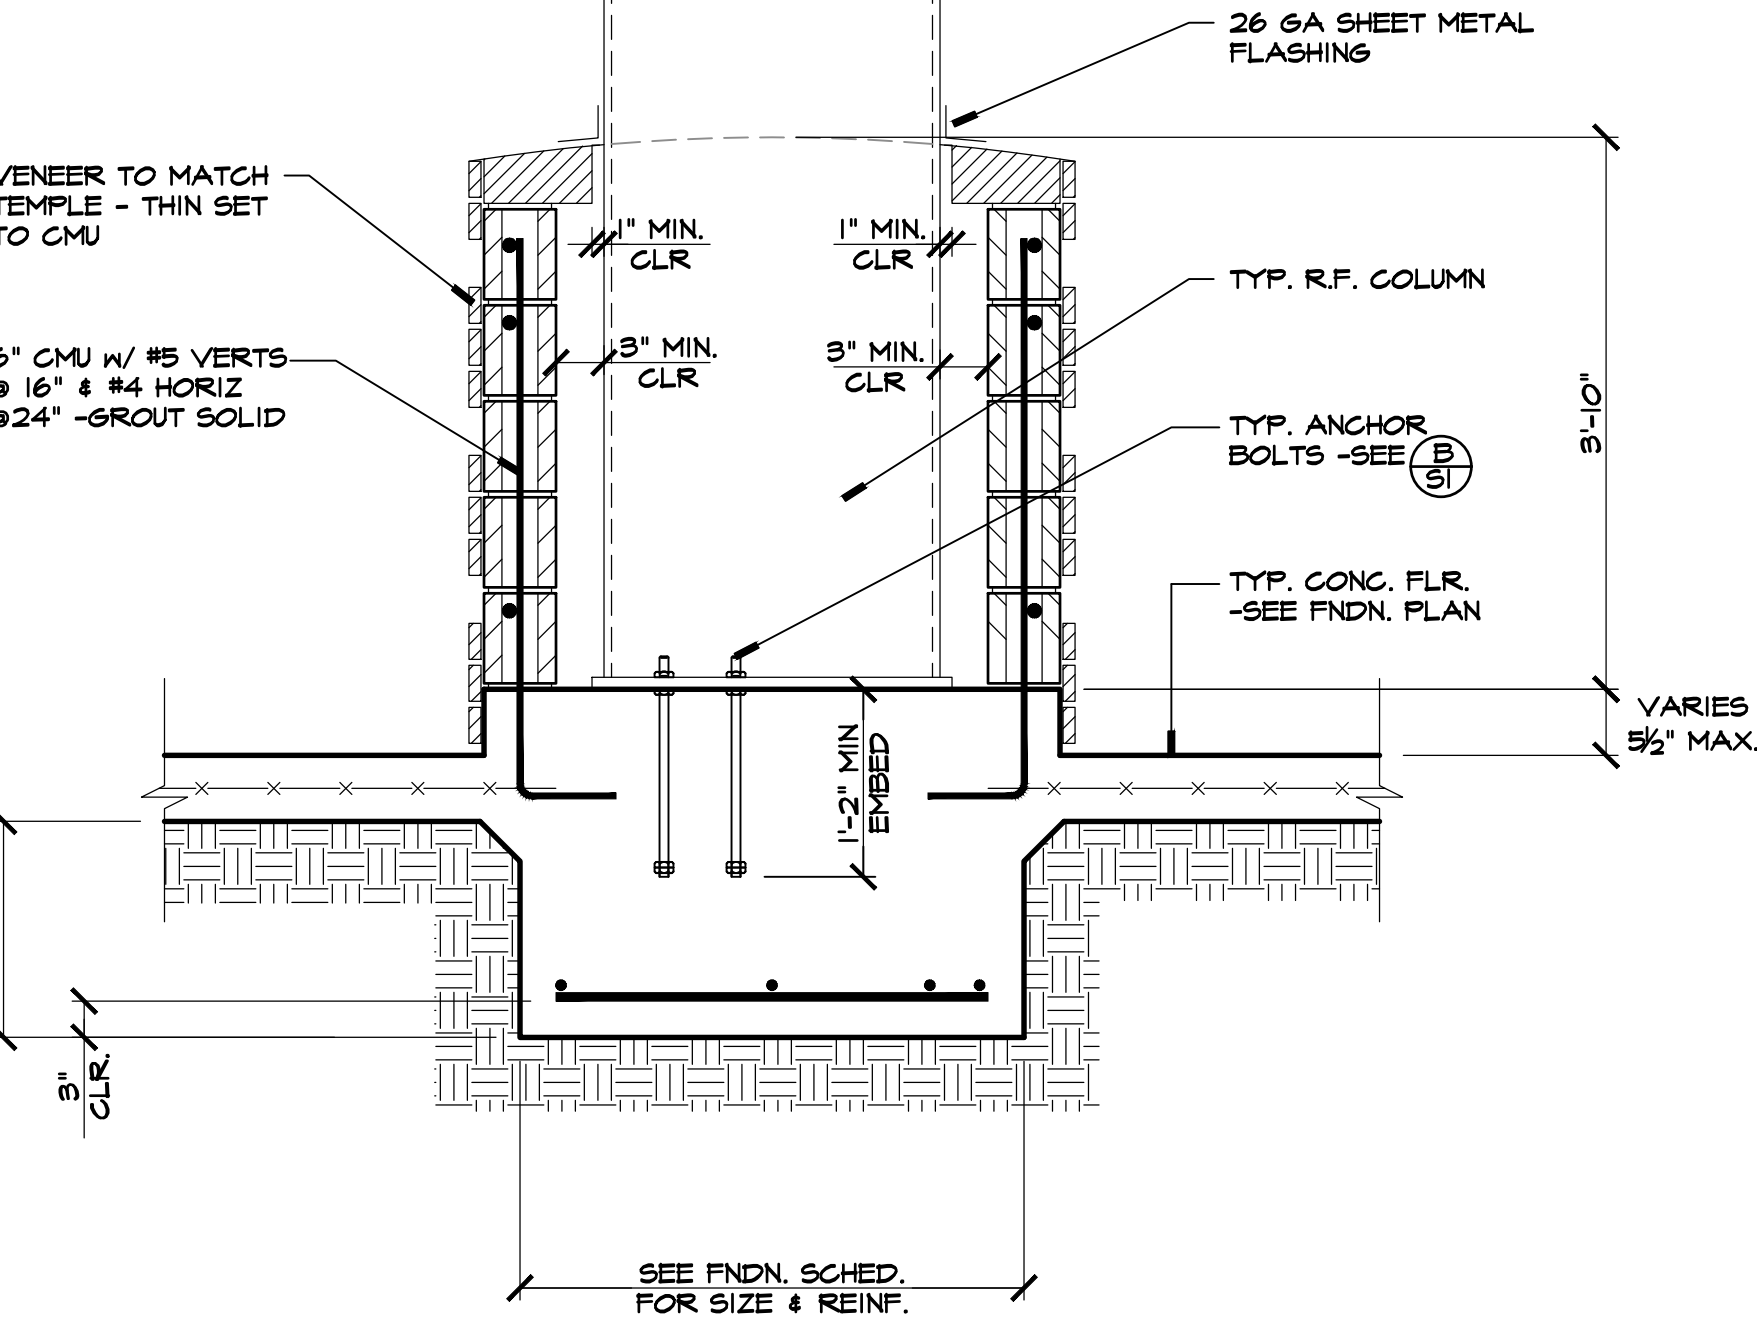

FNDN DETAIL

REVISIONS		BY
1	PLAN CHECK 8/1/2025	IT

MIKE SMITH
ENGINEERING, INC.
4 NORTH MAIN STREET
LODI, CALIFORNIA 95240
PHONE (209) 334-2332

TITLE:
FOUNDATION PLAN
DETAILS
GENERAL NOTES

PROJECT:
PROPOSED ROOF COVER FOR:
Sikh Temple
PROJECT LOCATION:
1950 SIKH TEMPLE ST.
STOCKTON, CA 95206

STAMP
REGISTERED PROFESSIONAL ENGINEER
MICHAEL W. SMITH
NO. 0044590
EXP. 3-31-24
CIVIL
STATE OF CALIFORNIA
THESE PLANS ARE PRELIMINARY
AND NOT FOR CONSTRUCTION
UNLESS THERE IS A WET SIGNED
SIGNATURE UPON STAMP

DRAWN
JCS
CHECKED
MS
DATE
2/21/24
SCALE
AS NOTED
JOB NO.
25314
SHEET
PHASE II
S1
3 OF 7 SHEETS